

lubos su plevėle ant viršaus

Exterior wall
created on 24.1.2023

Thermal protection

$U = 0,12 \text{ W}/(\text{m}^2\text{K})$

GEG 2020 Bestand*: $U < 0,24 \text{ W}/(\text{m}^2\text{K})$




Moisture proofing

No condensate



Heat protection


Temperature amplitude damping: 77
phase shift: 16,7 h
Thermal capacity inside: 51 kJ/m²K

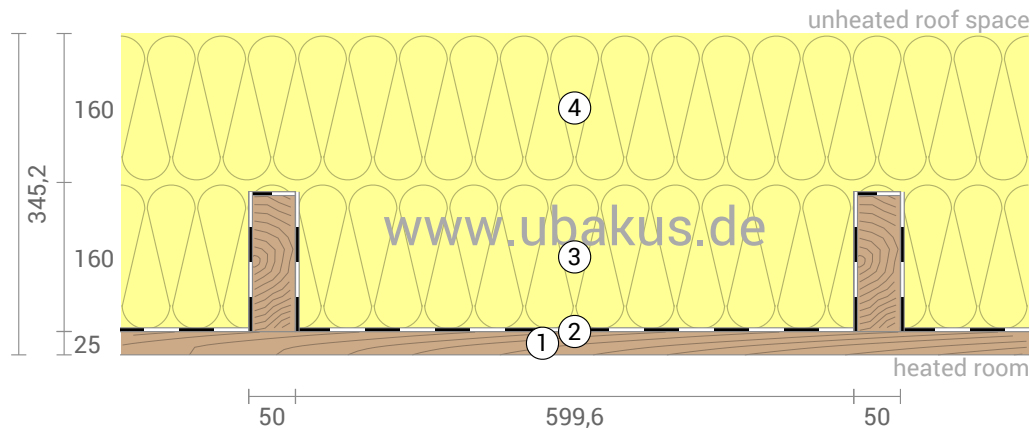

- ① Pine (25 mm)
- ② Foil, PE (0,2 mm)
- ③ Knauf Insulation Boden-Dämmplatte TPD (160 mm)
- ④ Knauf Insulation Boden-Dämmplatte TPD (160 mm)

Impact of each layer and comparison to reference values

For the following figure, the thermal resistances of the individual layers were converted in millimeters insulation. The scale refers to an insulation of thermal conductivity 0,040 W/mK.

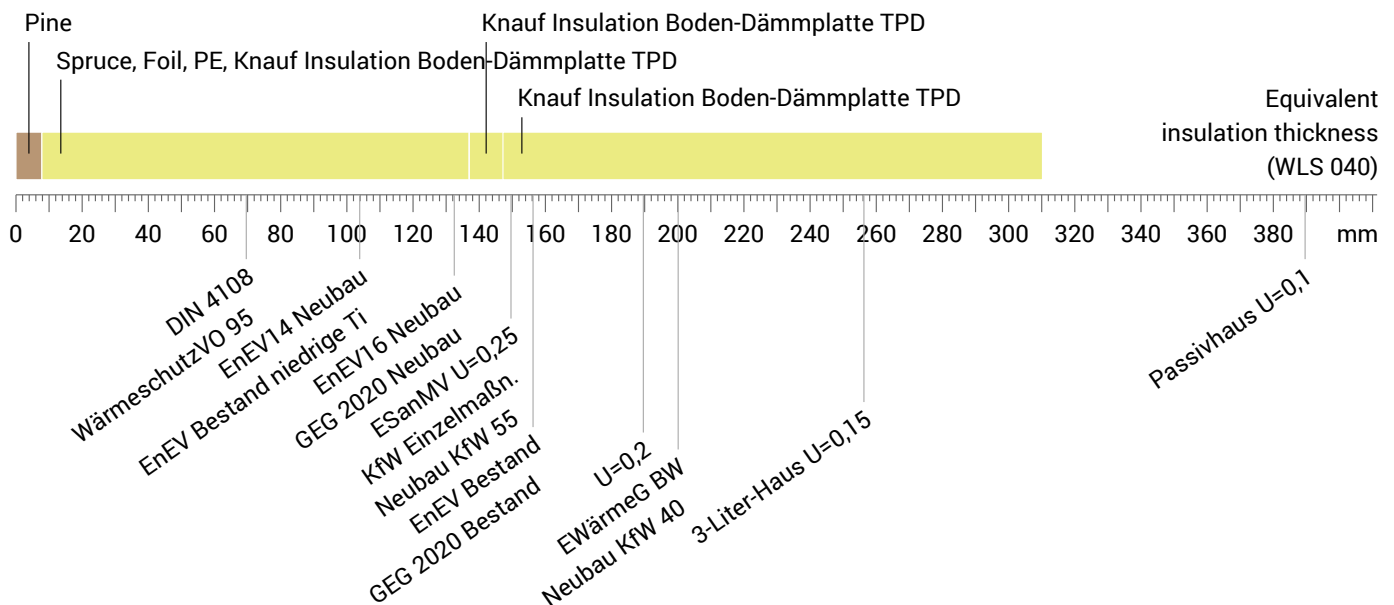


Inside air : 25,0°C / 60%
Non-heated room: -15,0°C / 80%
Surface temperature.: 23,2°C / -14,8°C

sd-value: 21,0 m

Thickness: 34,5 cm
Weight: 65 kg/m²
Heat capacity: 77 kJ/m²K

Temperature profile



Right: The component, drawn to scale.

Layers (from inside to outside)

#	Material	λ [W/mK]	R [m²K/W]	Temperatur [°C] min max	Weight [kg/m²]
	Thermal contact resistance*		0,130	23,2 25,0	
1	2,5 cm Pine	0,130	0,192	21,6 23,9	13,0
2	0,02 cm Foil, PE	0,400	0,001	21,9 23,0	0,2
3	16 cm Knauf Insulation Boden-Dämmplatte TPD	0,040	4,000	4,3 23,0	22,3
	15 cm Spruce (Width: 5 cm)	0,130	1,154	8,9 21,9	5,2
	0,02 cm Foil, PE (Width: 5 cm)	0,400	0,001	8,9 9,3	0,0
	15 cm Foil, PE (Width: 0,02 cm)	0,400	0,375	8,9 21,9	0,0
	15 cm Foil, PE (Width: 0,02 cm)	0,400	0,375	8,9 21,9	0,0
4	16 cm Knauf Insulation Boden-Dämmplatte TPD	0,040	4,000	-14,8 7,5	24,0
	Thermal contact resistance*		0,130	-15,0 -14,8	
	34,52 cm Whole component		8,001		64,7

*Thermal contact resistances according to DIN 6946 for the U-value calculation. Rsi=0,25 and Rse=0,04 according to DIN 4108-3 were used for moisture proofing and temperature profile.

Surface temperature inside (min / average / max):	23,2°C	23,8°C	23,9°C
Surface temperature outside (min / average / max):	-14,8°C	-14,8°C	-14,8°C

lubos su plevėle ant viršaus, $U=0,12 \text{ W/(m}^2\text{K)}$

Moisture proofing

For the calculation of the amount of condensation water, the component was exposed to the following constant climate for 90 days: inside: 25°C und 60% Humidity; outside: -15°C und 80% Humidity (Climate according to user input).


This component is free of condensate under the given climate conditions.

#	Material	sd-value [m]	Condensate [kg/m²] [Gew.-%]	Weight [kg/m²]
1	2,5 cm Pine	0,50	-	13,0
2	0,02 cm Foil, PE	20,00	-	0,2
3	16 cm Knauf Insulation Boden-Dämmplatte TPD	0,16	-	22,3
	15 cm Spruce (Width: 5 cm)	3,00	-	5,2
	0,02 cm Foil, PE (Width: 5 cm)	20,00	-	0,0
	15 cm Foil, PE (Width: 0,02 cm)	20,00	-	0,0
	15 cm Foil, PE (Width: 0,02 cm)	20,00	-	0,0
4	16 cm Knauf Insulation Boden-Dämmplatte TPD	0,16	-	24,0
	34,52 cm Whole component	21,02	0	64,7

Humidity

The temperature of the inside surface is 23,2 °C leading to a relative humidity on the surface of 67%.Mould formation is not expected under these conditions.

The following figure shows the relative humidity inside the component.


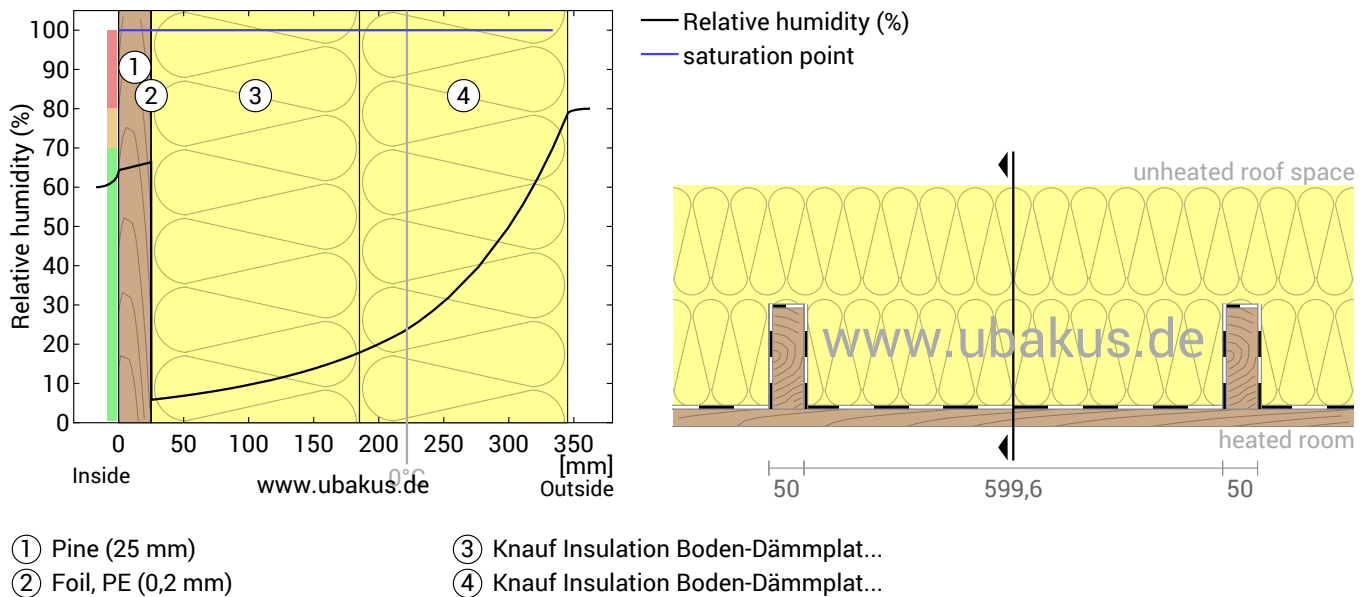


Notes: Calculation using the Ubakus 2D-FE method. Convection and the capillarity of the building materials were not considered. The drying time may take longer under unfavorable conditions (shading, damp / cool summers) than calculated here.

lubos su plevėle ant viršaus, $U=0,12 \text{ W/(m}^2\text{K)}$

Heat protection

The following results are properties of the tested component alone and do not make any statement about the heat protection of the entire room:

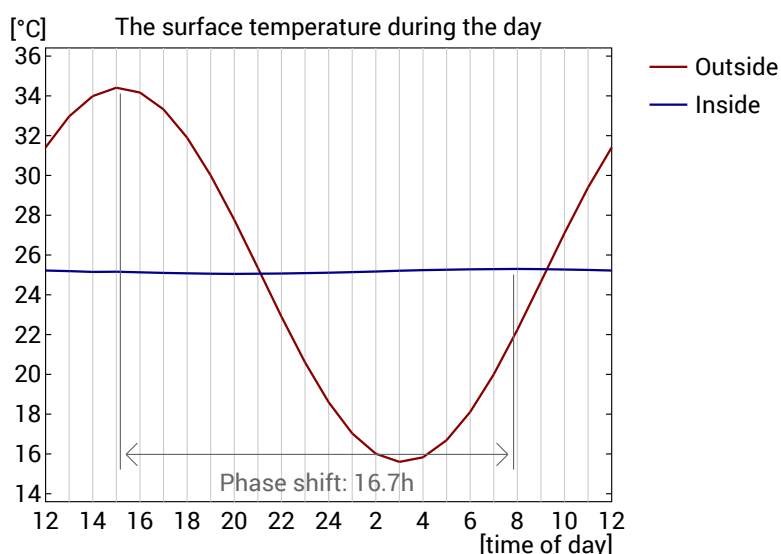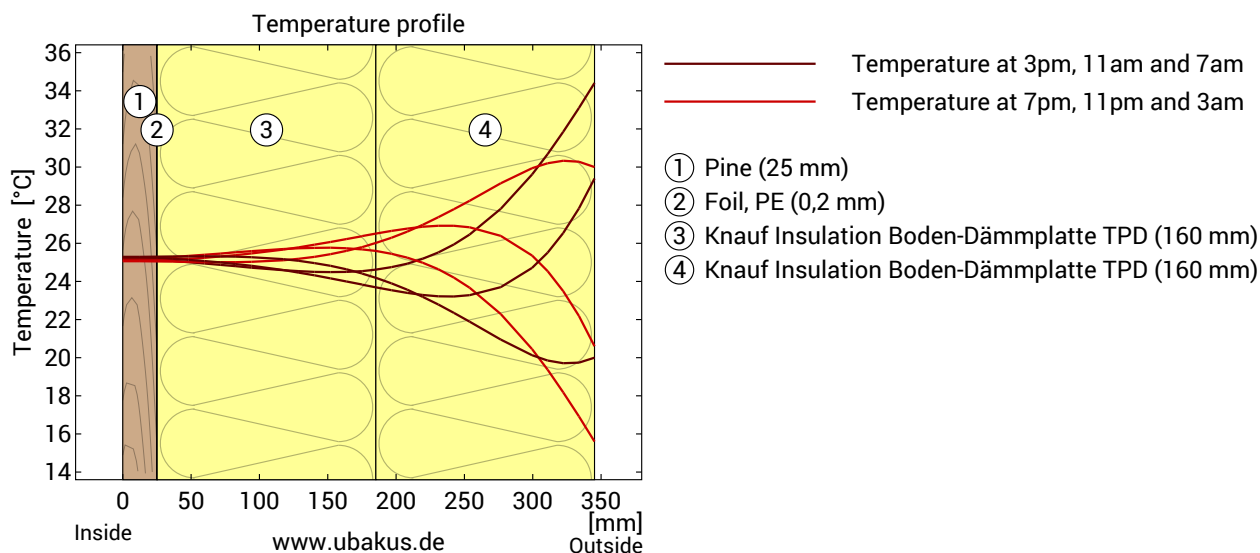

Top: Temperature profile within the component at different times. From top to bottom, brown lines: at 3 pm, 11 am and 7 am and red lines at 7 pm, 11 pm and 3 am.

Bottom: Temperature on the outer (red) and inner (blue) surface in the course of a day. The arrows indicate the location of the temperature maximum values . The maximum of the inner surface temperature should preferably occur during the second half of the night.

Phase shift*	16,7 h	Heat storage capacity (whole component):	77 kJ/m ² K
Amplitude attenuation **	76,9	Thermal capacity of inner layers:	51 kJ/m ² K
TAV ***	0,013		

* The phase shift is the time in hours after which the temperature peak of the afternoon reaches the component interior.

** The amplitude attenuation describes the attenuation of the temperature wave when passing through the component. A value of 10 means that the temperature on the outside varies 10x stronger than on the inside, e.g. outside 15-35 °C, inside 24-26 °C.

*** The temperature amplitude ratio TAV is the reciprocal of the attenuation: $TAV = 1 / \text{amplitude attenuation}$

Note: The heat protection of a room is influenced by several factors, but essentially by the direct solar radiation through windows and the total amount of heat storage capacity (including floor, interior walls and furniture). A single component usually has only a very small influence on the heat protection of the room.

The calculations presented above have been created for a 1-dimensional cross-section of the component.